

# ADB Schematic

1. Detectors are Latching Detectors
2. Resetting of system is by resetting OBGV, or pressing button on ADB box.


Roof Level

Stair vent  
See Detail AOVL1

Top Floor

1st Floor

Ground Floor

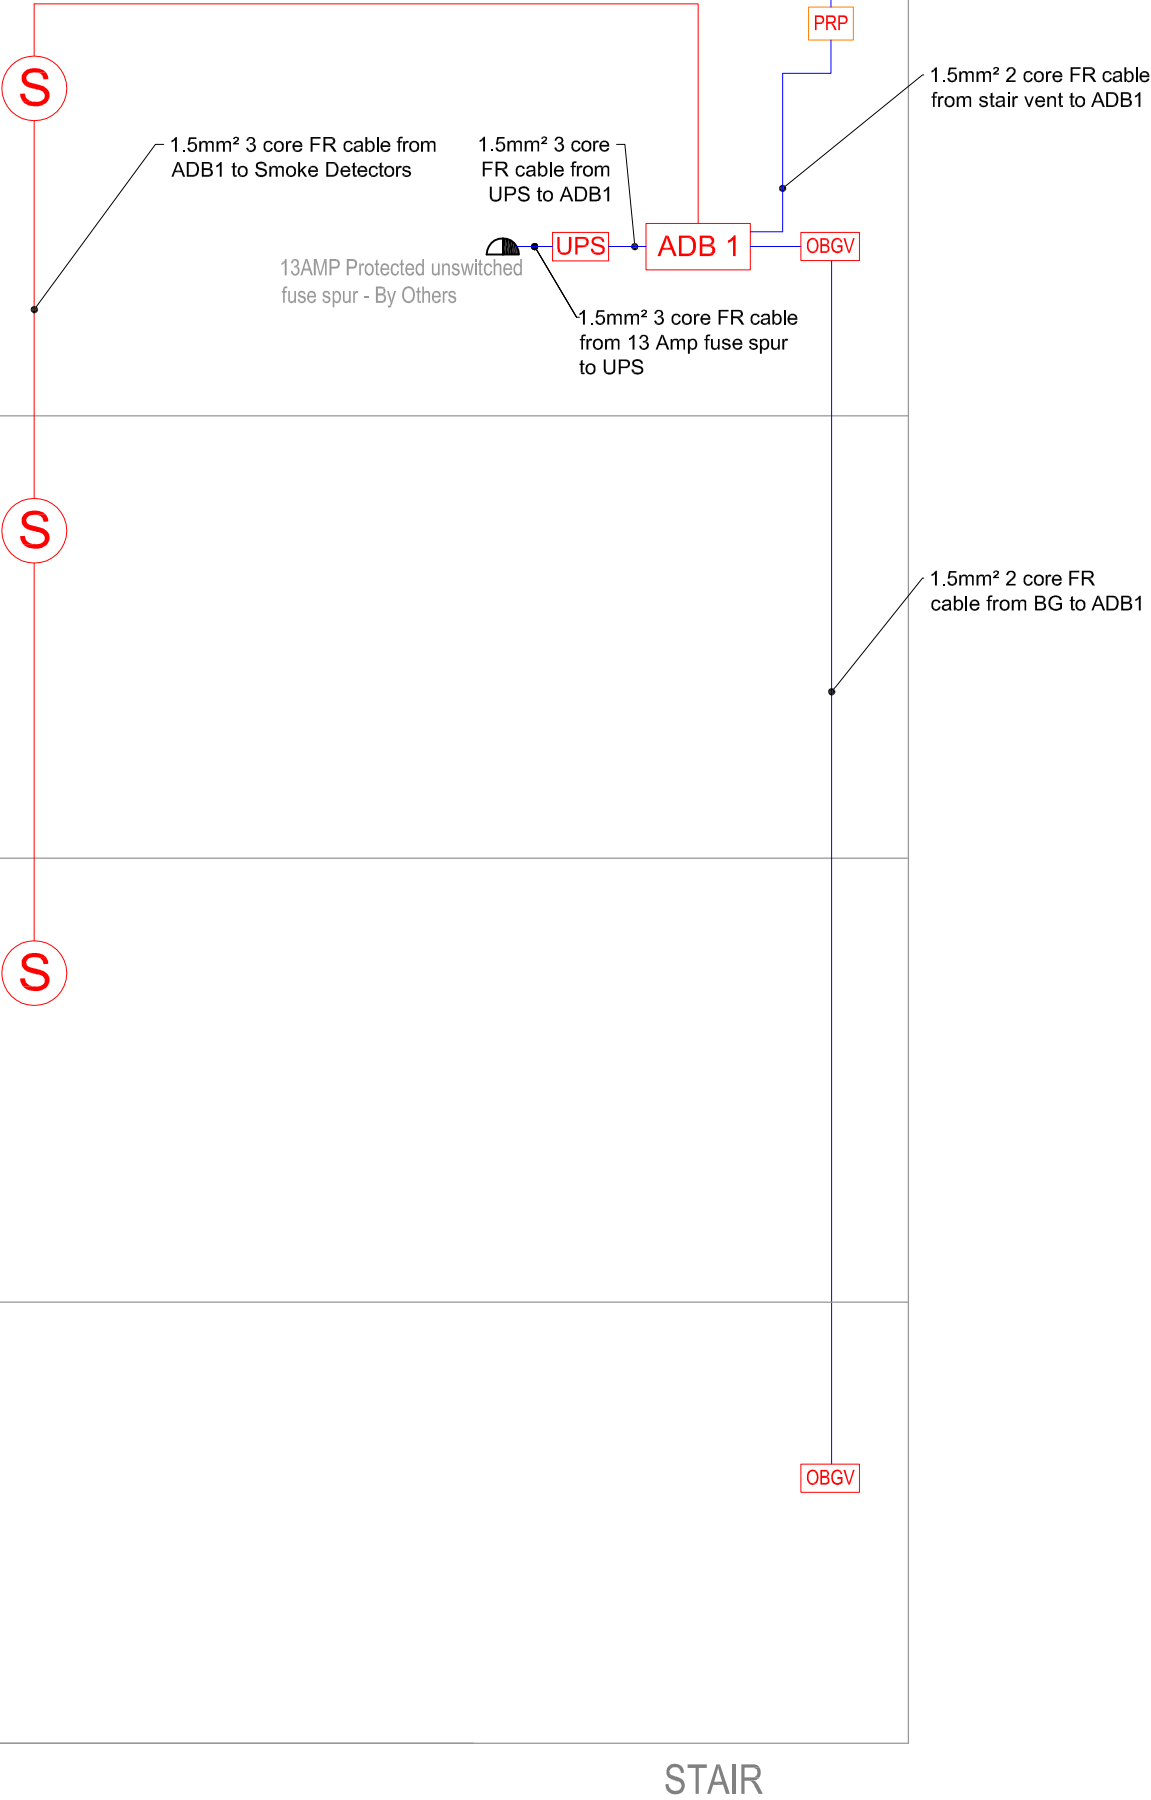

Rev	Date	Comment	Checked by

General notes and Legend:

- ADB 1

ADB 1 Box
- UPS

Universal Power Supply
- 13 amp Protected unswitched fuse spur - By client
- OBGV

Orange Break Glass volt free contact
- Stair Vent
- S

Smoke Detector

152/154 London Road  
Greenhithe.  
Kent DA9 9JW  
Tel 01322 387411 Fax 01322 386361  
Email info@firedesignsolutions.com

ADB Schematic

These drawings are for illustrative purposes only, showing the requirements needed for our equipment.